


MINI-BOILER HOOKUP (EMB-5, EMB-9)

TWO ZONES, SAME SIZE

3

SEE
PAGE 1

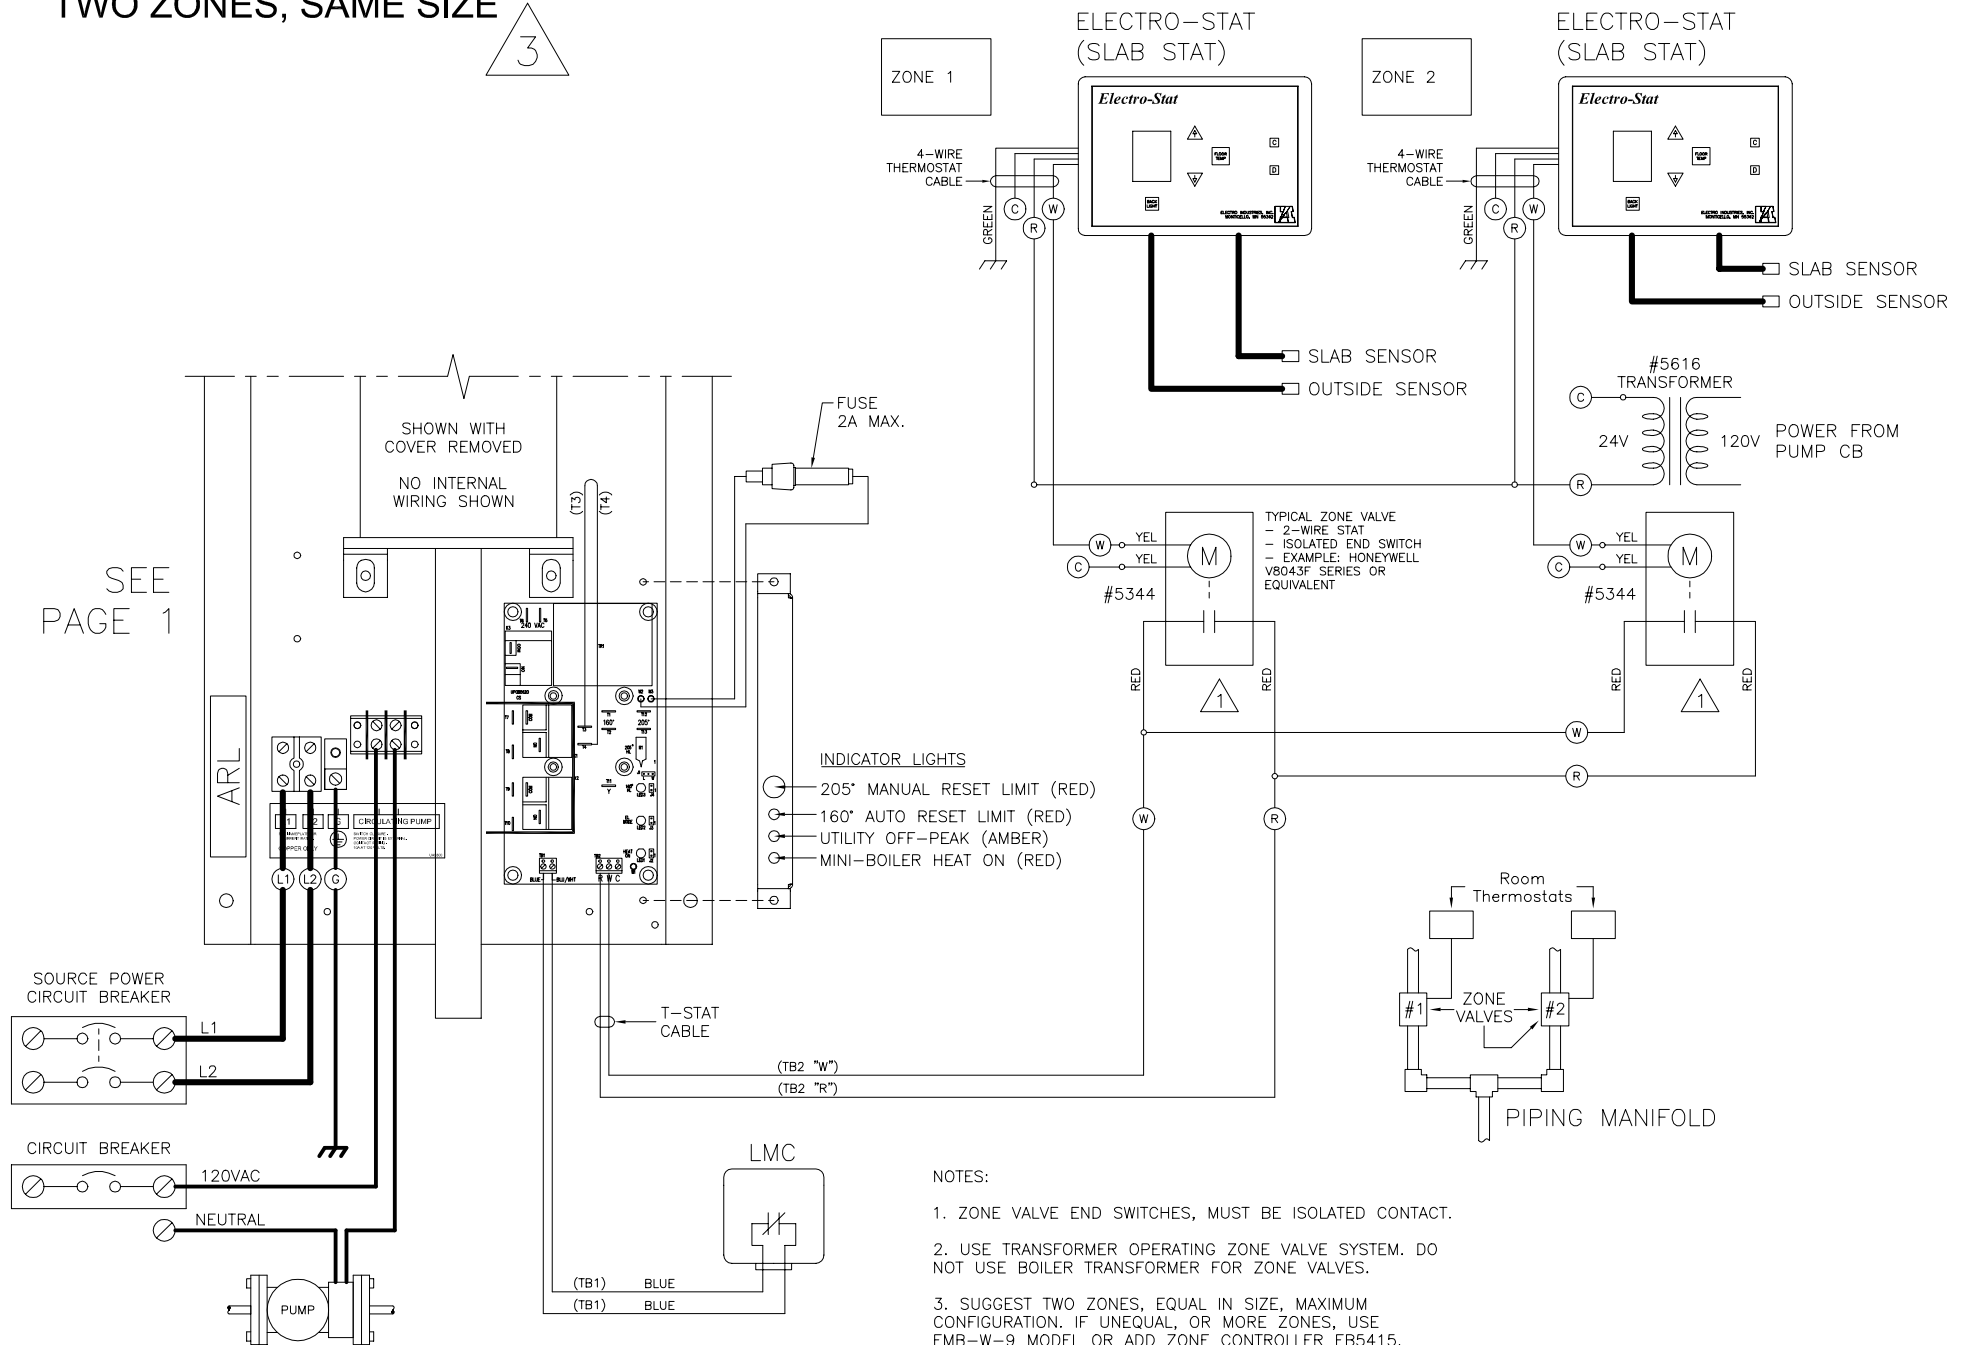

NOTES:

1. ZONE VALVE END SWITCHES, MUST BE ISOLATED CONTACT.
2. USE TRANSFORMER OPERATING ZONE VALVE SYSTEM. DO NOT USE BOILER TRANSFORMER FOR ZONE VALVES.
3. SUGGEST TWO ZONES, EQUAL IN SIZE, MAXIMUM CONFIGURATION. IF UNEQUAL, OR MORE ZONES, USE EMB-W-9 MODEL OR ADD ZONE CONTROLLER EB5415. REQUEST DRAWINGS BH004 & BH005.