

Specification Sheet - Electric Duct Heater

STANDARD EQUIPMENT

- Control wiring terminals
- Stage LED indicators
- Quiet DC power relays
- Hi-limits, automatic reset - 135° F & 150° F/180° fused link
- Compact enclosure
- Two element sizes available - 8 x 10/8 x 16
- “C” model (last digit) includes 16”W x 16”D starter plenum
- 5-year element warranty
- 2-year parts warranty
- Unique design allows for simplified installation
- ARL listed
- Made in the USA

TEMPERATURE RISE CHART*

Temperature Rise Needed		80° F	70° F	60° F	50° F	40° F	30° F
Model	Watts	CFM	CFM	CFM	CFM	CFM	CFM
EM-DI1025H	9600	378	432	504	604	756	1007
EM-DI1535H	14400	567	648	756	907	1133	1511
EM-DI2035H	19200	756	863	1007	1209	1511	2015
EM-DI1025L	9600	378	432	504	604	756	1007
EM-DI1535L	14400	567	648	756	907	1133	1511
EM-DI2035L	19200	756	863	1007	1209	1511	2015
EM-DI1025C	9600	378	432	504	604	756	1007
EM-DI1535C	14400	567	648	756	907	1133	1511
EM-DI2035C	19200	756	863	1007	1209	1511	2015

*Typically the maximum temperature rise for this product is 40° F for room air inlet. If used for make-up air, larger temperature rises are permissible, see table above.

ELECTRIC SUPPLY

Model	kW	Btu/h	Amps	Fuse	Phase	Voltage	Source CB	Shipping Weight	Installation Manual	Minimum CFM
EM-DI1025H	9.6	32,760	40	N/A	1-60	240	50	12	EI504	370
EM-DI1535H	14.4	49,150	60	30 + 50	1-60	240	80	16	EI504	560
EM-DI2035H	19.2	65,530	80	50 + 50	1-60	240	100	19	EI504	750
EM-DI1025L	9.6	32,760	40	N/A	1-60	240	50	15	EI504	370
EM-DI1535L	14.4	49,150	60	30 + 50	1-60	240	80	19	EI504	560
EM-DI2035L	19.2	65,530	80	50 + 50	1-60	240	100	21	EI504	750
EM-DI1025C	9.6	32,760	40	N/A	1-60	240	50	28	EI505	370
EM-DI1535C	14.4	49,150	60	30 + 50	1-60	240	80	31	EI505	560
EM-DI2035C	19.2	65,530	80	50 + 50	1-60	240	100	33	EI505	750

INSTALLATION SPECIFICATIONS

When installing this duct heater, NEC 424, Part IV, Duct Heaters, applies.

When installed in an “inline” duct or round pipe adapter for a general distribution boost heater or make-up air application, observe the following guidelines:

1. This product must be installed in a metal duct, size of element rack.
2. There shall be no insulation on the inside of this sheet metal duct section.
3. Any flex-pipe or other insulated pipe must be at least 24” from the electric element.
4. Mounting - there must be at least 2” air clearance around all sides of this sheet metal duct section.
5. If there is a need to insulate this duct section for moisture condensation or in an unheated compartment, it is permissible to wrap insulation around the exterior of this metal duct section.
6. The control box must be positioned so it will not receive dripping water or collection of moisture.




Specifications subject to change without notice,
all rights reserved.



ELECTRO INDUSTRIES, INC.

2150 West River Street, PO Box 538, Monticello, MN 55362
763.295.4138 • 800.922.4138 • fax 763.295.4434
sales@electromn.com • www.electromn.com


SPECIFICATION DRAWING CUSTOMER DUCT HEATER

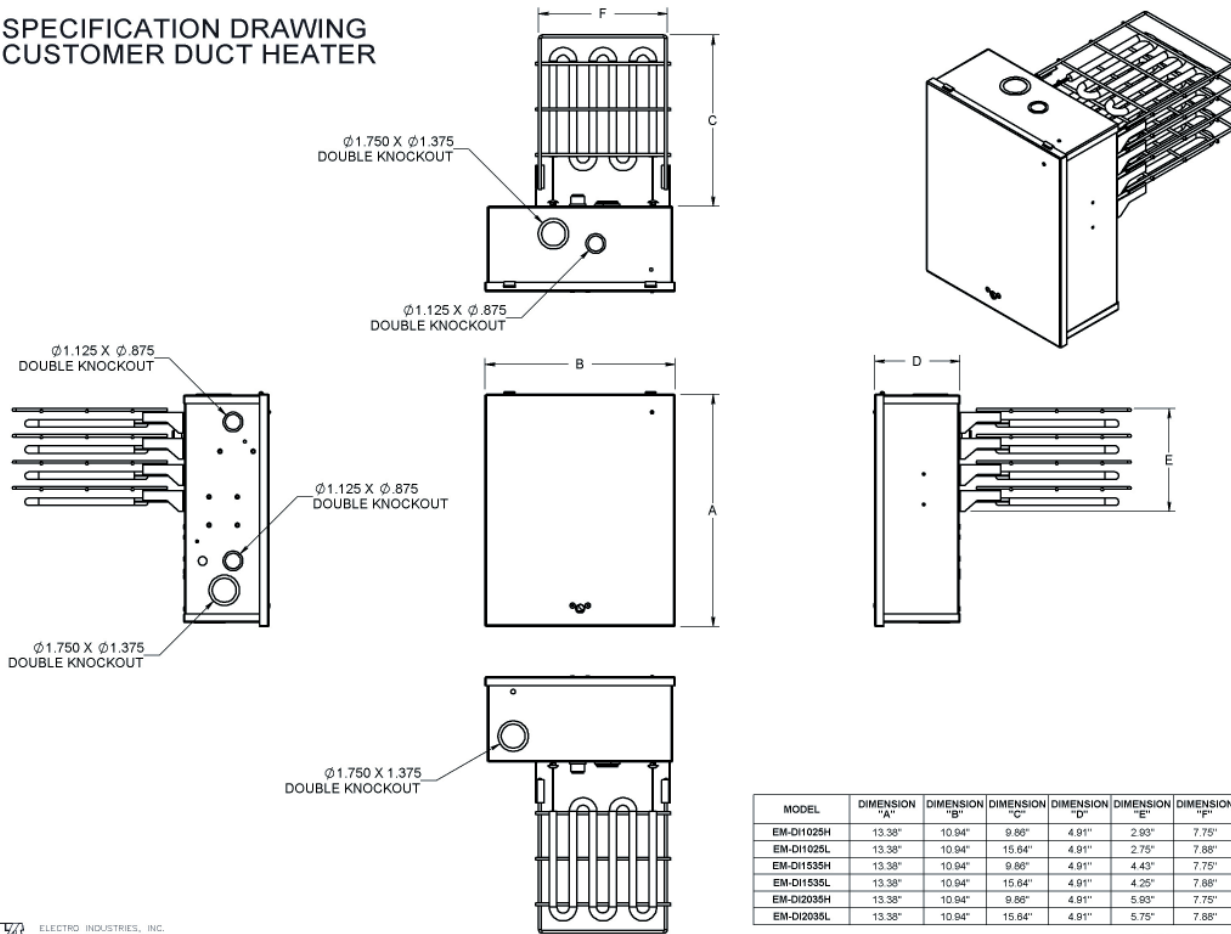

ELECTRO INDUSTRIES, INC.
MONTICELLO, MN 55362

ART-322-00 1.0

SPECIFICATION DRAWING CUSTOMER DUCT HEATER

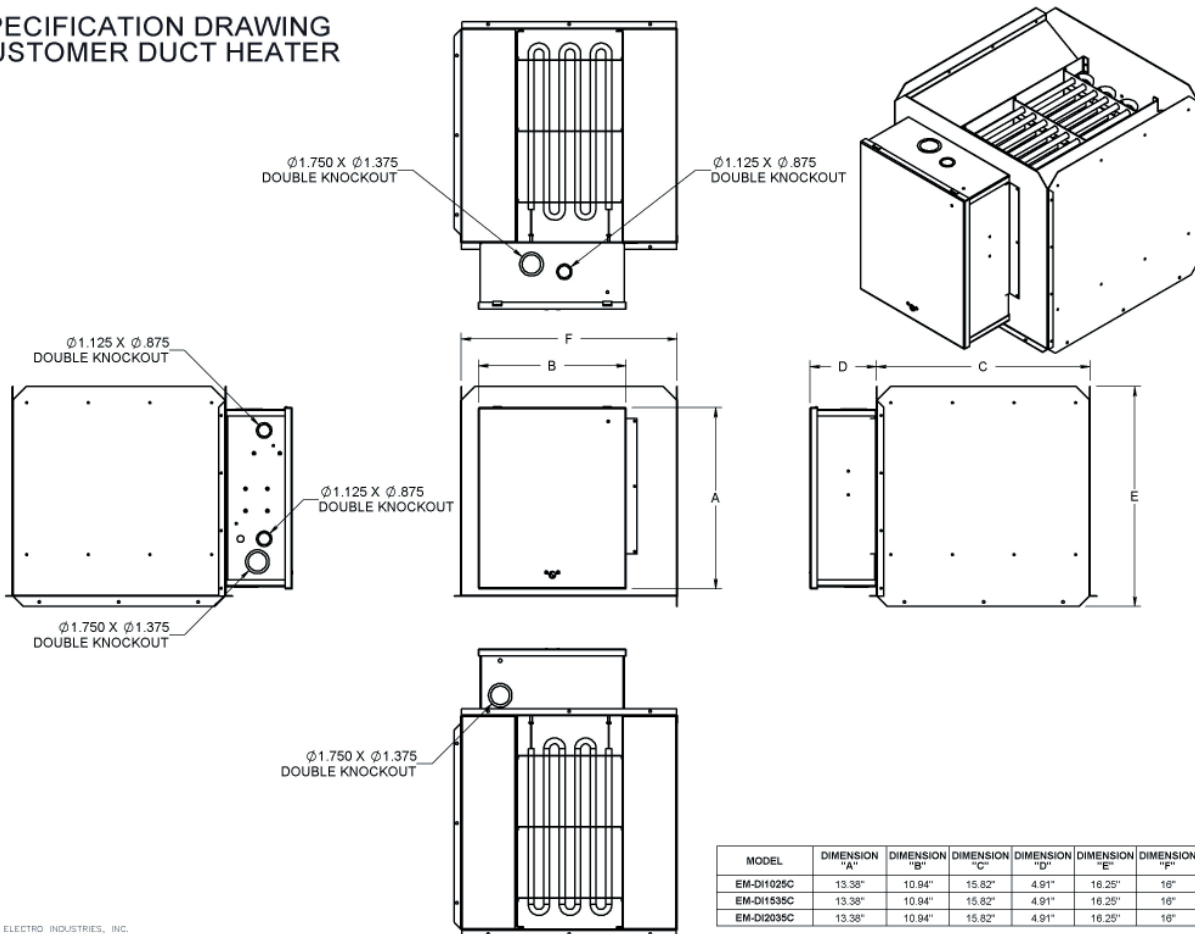

ELECTRO INDUSTRIES, INC.
MONTICELLO, MN 55362

ART-321-00 1.0