




MYSON

Hydronic Heating "Closed" Loop Piping System

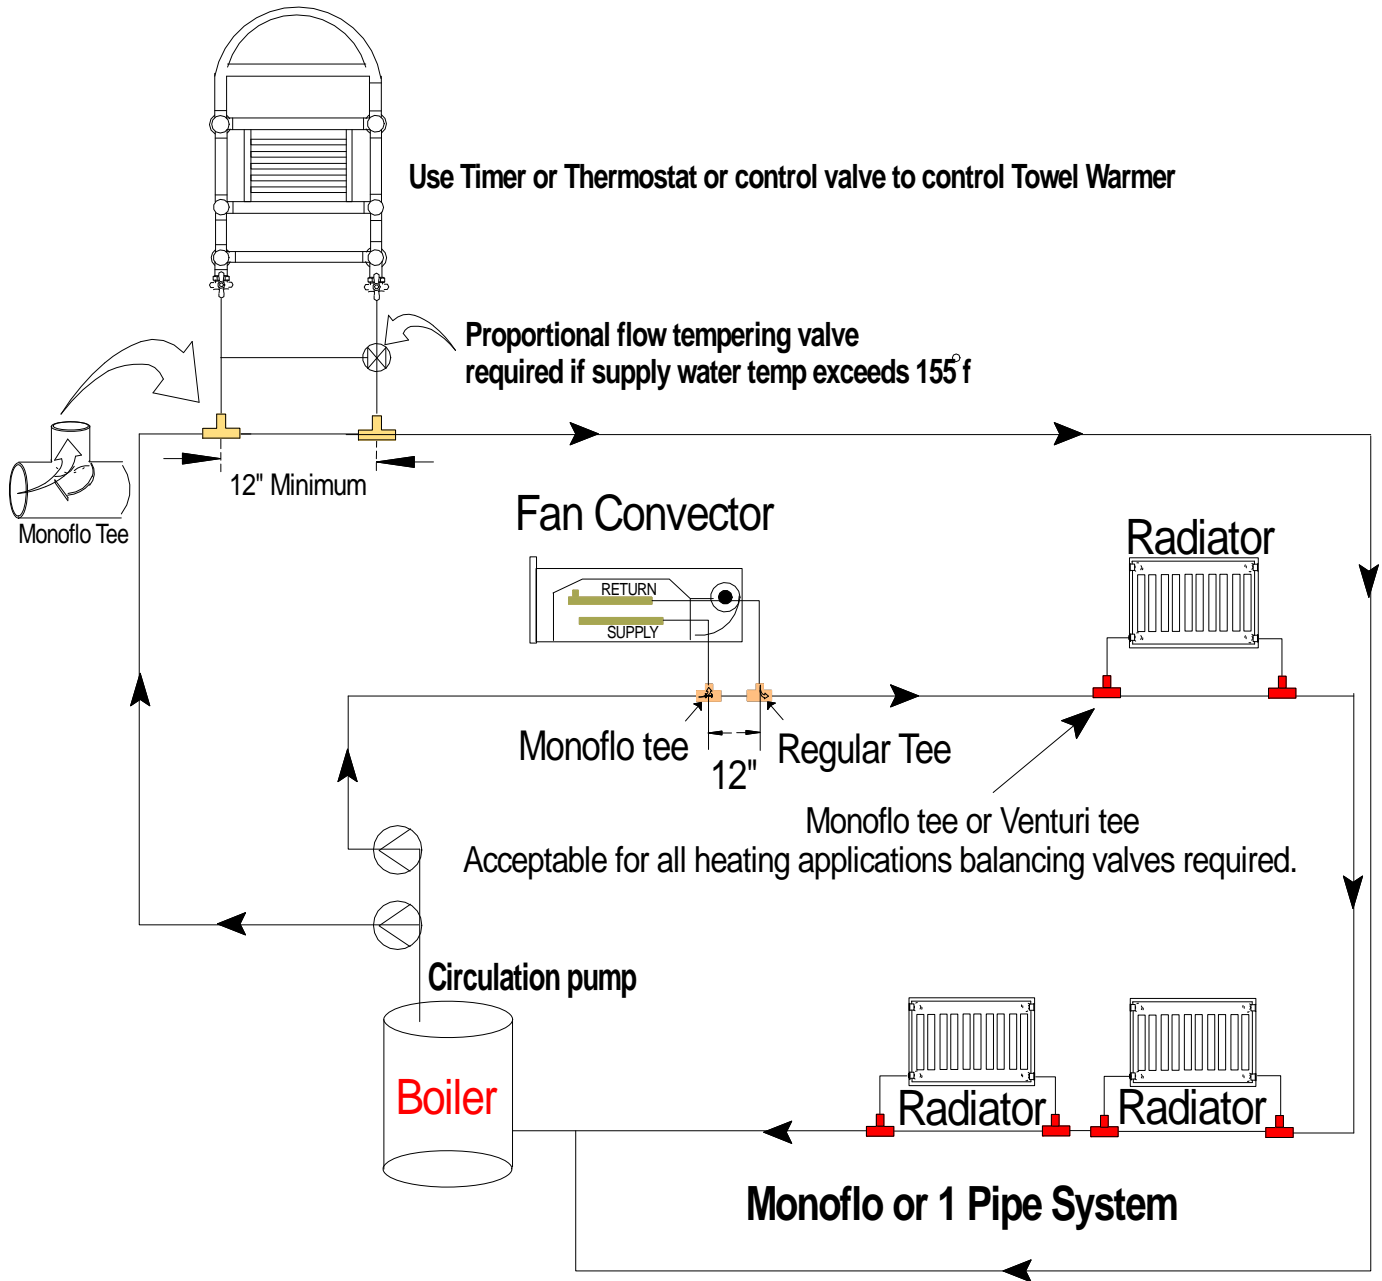

This diagram is typical of a **"CLOSED"** loop Hydronic heating system. Myson towel warmers and radiators are ideally suited for installation on a "CLOSED" system. Installation on a closed system prevents oxygenation (rusting) of the steel used in the manufacture of Myson radiators and some models of towel warmers. A closed system will, in most cases, prohibit de-zincification of towel warmers made from brass.